
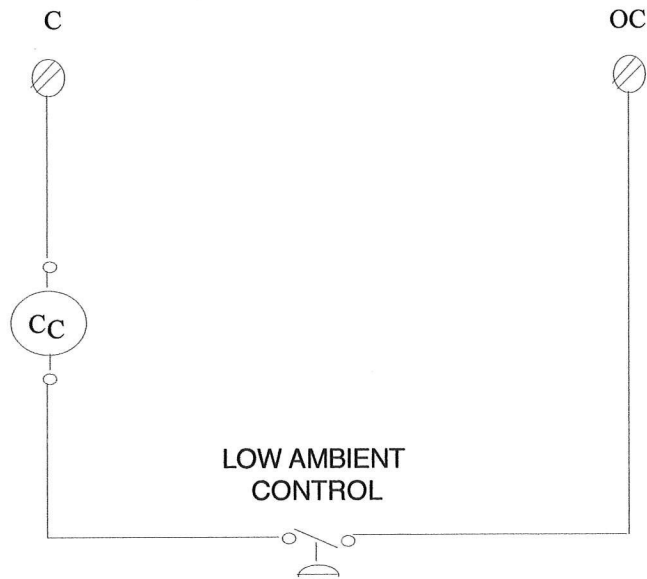


208 / 230 VOLT - 1 PHASE

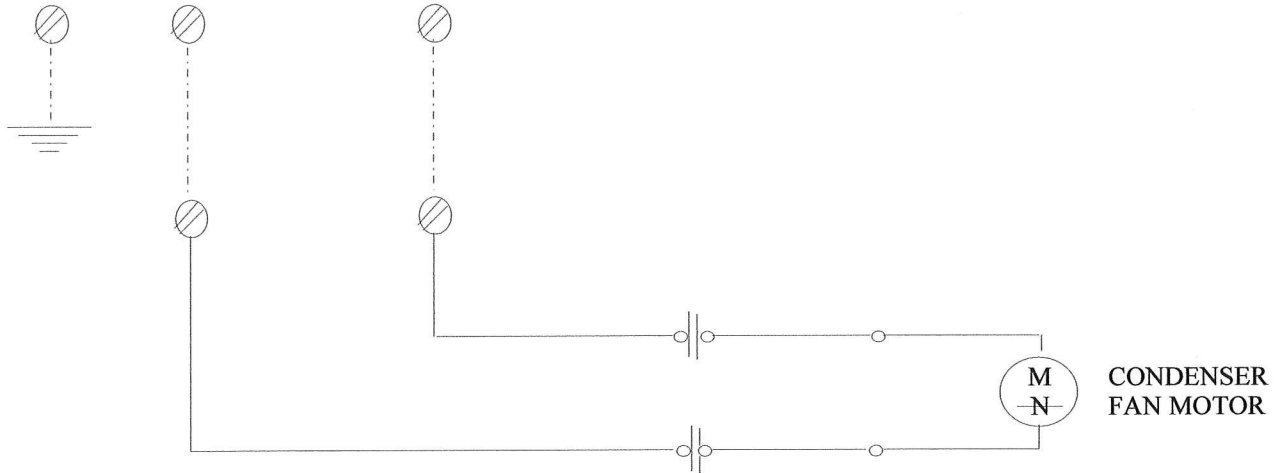

MAKES ON PRESSURE RISE

RECOMMENDED SETTINGS: 50 PSI DIFFERENTIAL  
 MAKES AT 200 PSI  
 BREAK AT 150 PSI

NOTE 1: FIELD SUPPLIED DISCONNECT REQUIRED.

LEGEND

- M MOTOR
- Cc OUTDOOR FAN CONTACTOR COIL
- C OUTDOOR FAN CONTACTOR
- LOW VOLTAGE FACTORY WIRING
- - - - - HIGH VOLTAGE FIELD SUPPLIED
- ⊗ TERMINAL CONNECTION

Change Temp. Controller			Date
REVISIONS			01/04/10
<b>DRY AIRE SYSTEMS</b>			No. 1109
DRN: DWS	CKD: RJG	AP'VD: JDS	SCALE: NONE
Outdoor Condenser: OC-25 / 30 / 35 / 40 / 45			